

Building Circulating Pumps


Lead Pump	CP-1	On
● Temp. In	72	°F
● Temp. Out	72	°F
● Press. In	20	Psi
● Press. Out	45	Psi
Rated Pump Amps	22	amp
Actual Pump Amps	16	amp

Pressure & Temperature Access Points


Equipment Inspections

- ✓ Restroom Exhaust
- ✓ Building Loop Strainer
- ✓ Tower Loop Strainer
- ✓ Building Loop Expansion Tank
- ✓ Control Panel, wiring, set-points
- ✓ Pump Motor Amps
- ✓ Tower Fan Motor Amps
- ✓ Tower Lubrication/Check Belt
- ✓ Tower VSD & Controls
- ✓ Pressure & Relief Valves (2)

73°F Outdoor Temperature Today



Water Treatment Tank Level
80%

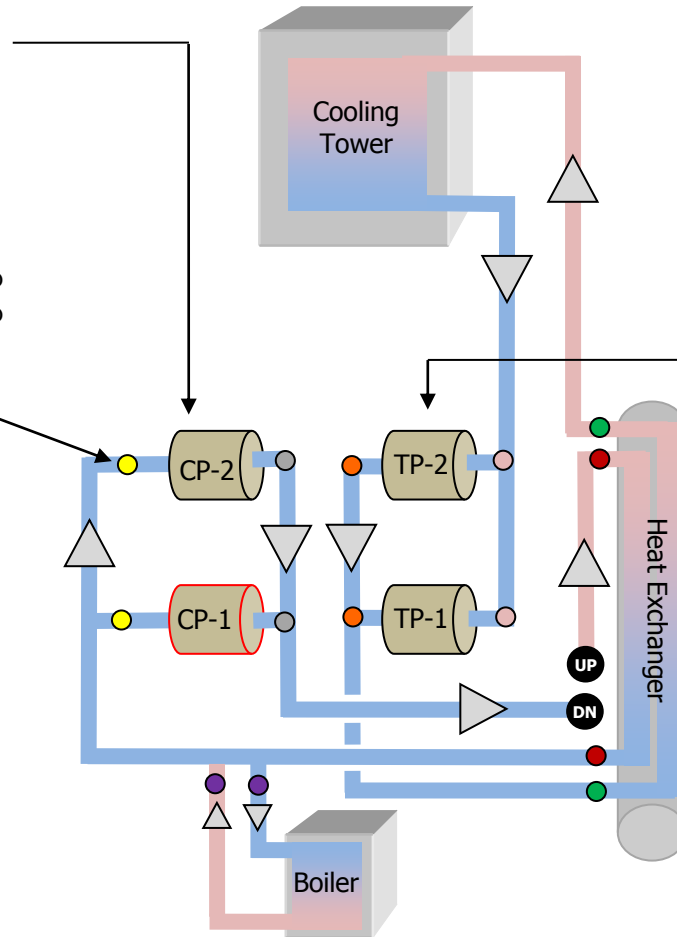

Cooling Tower Pumps

Lead Pump	TP-1	On
● Temp. In	65	°F
● Temp. Out	65	°F
● Press. In	0	Psi
● Press. Out	0	Psi
Rated Pump Amps	27	amp
Actual Pump Amps	24	amp

Heat Exchanger

● Tower Loop Split	5	°F
	8	Psi
● Building Loop Split	4	°F
	24	Psi

Boiler

● Boiler Loop Split	0	°F
	3#	Psi